


## REALice Wall Unit Installation Diagram

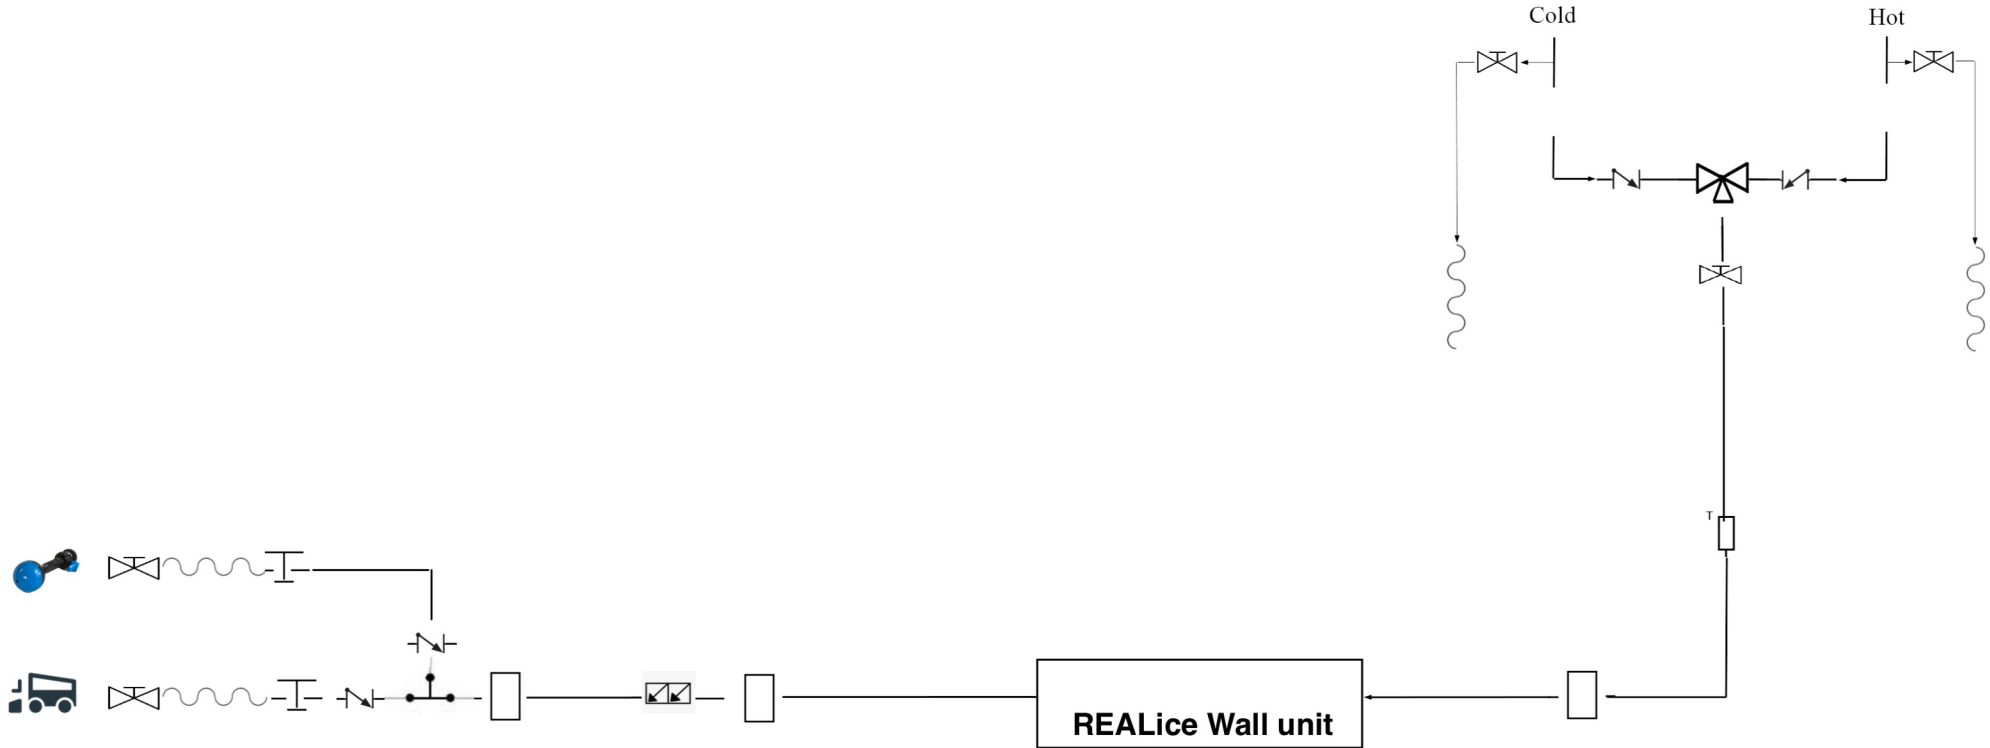

**IMPORTANT**

This schematic is for illustration purposes only. All national safety and local codes must be adhered to when installing.

Ensure that there is static pressure of minimum 45 PSI otherwise add a booster pump.

Installing a thermostatic mixing valve or ball vavles is recommended but not necessary.

Ensure that the REALice wall unit is **mounted to the wall with solid brackets**. Adding more piping after the system with **additional brackets** helps to reduce the risk of the wall unit being ripped off in case of an accident.

The REALice wall unit can be installed horizontally or vertically.

Before using the REALice system, **consult user guidelines** for best results

PLUMBING LEGEND			
SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION
	Valve		Backflow prevention
	Check valve <sup>1</sup>		
	Thermostatic mixing valve or ball valves		Security bracket
	Temperature gauge		Flexible hose
	Hose outlet		

*For illustration purposes only*

